The Following pictures depict examples of safety and health violations.





.....

NOING YOUR TRUE NOR












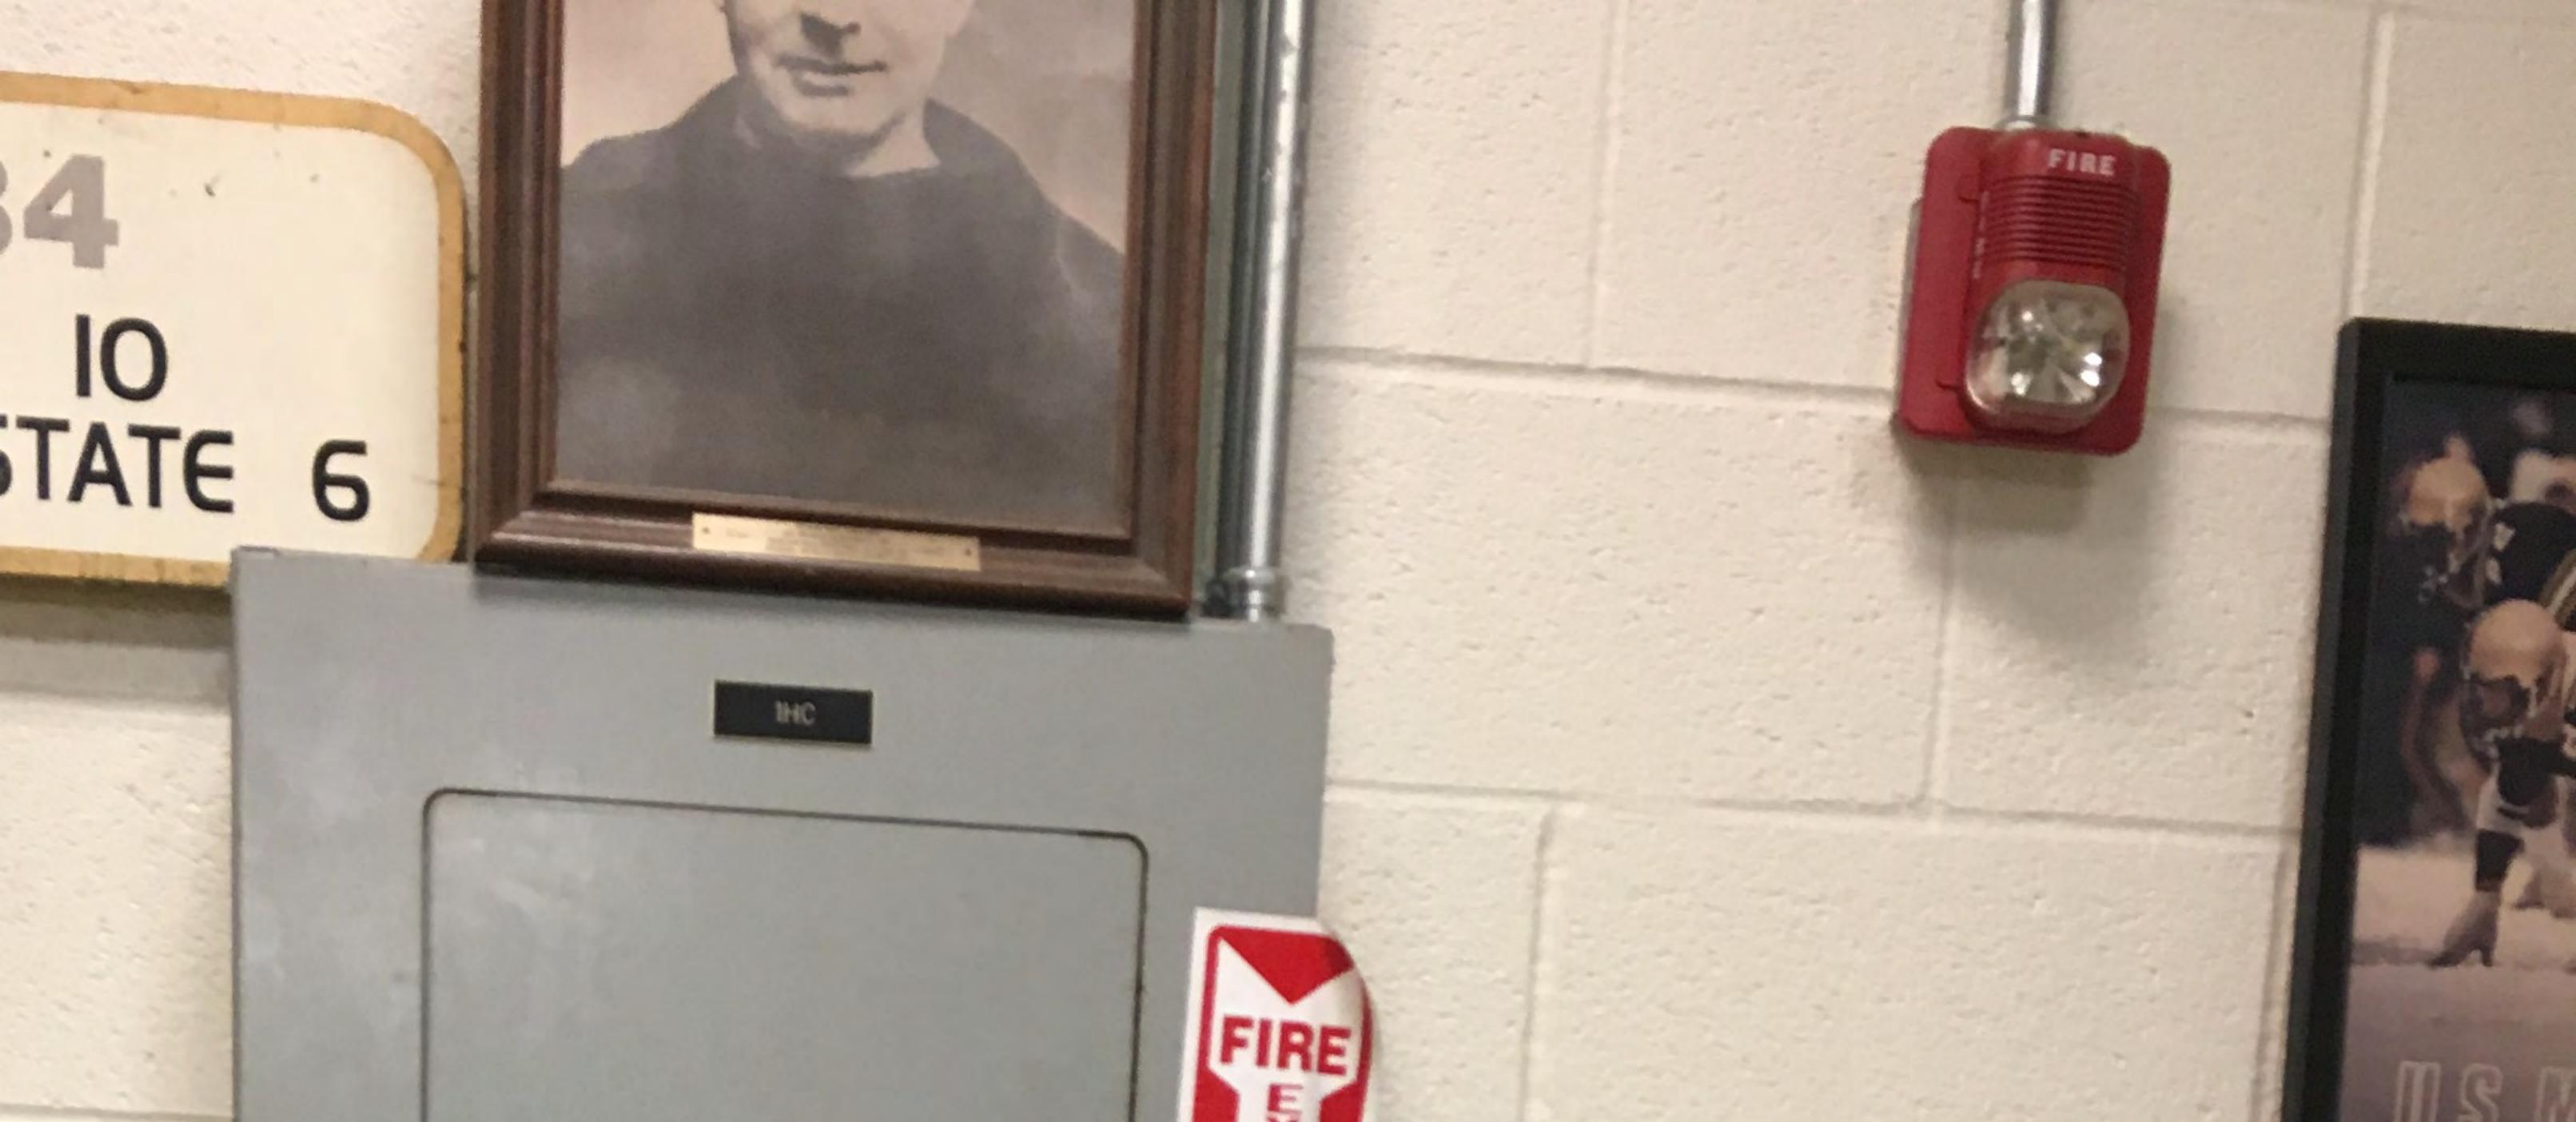


Electrical/fire hazard: blocked breaker panel and blocked fire extinguisher







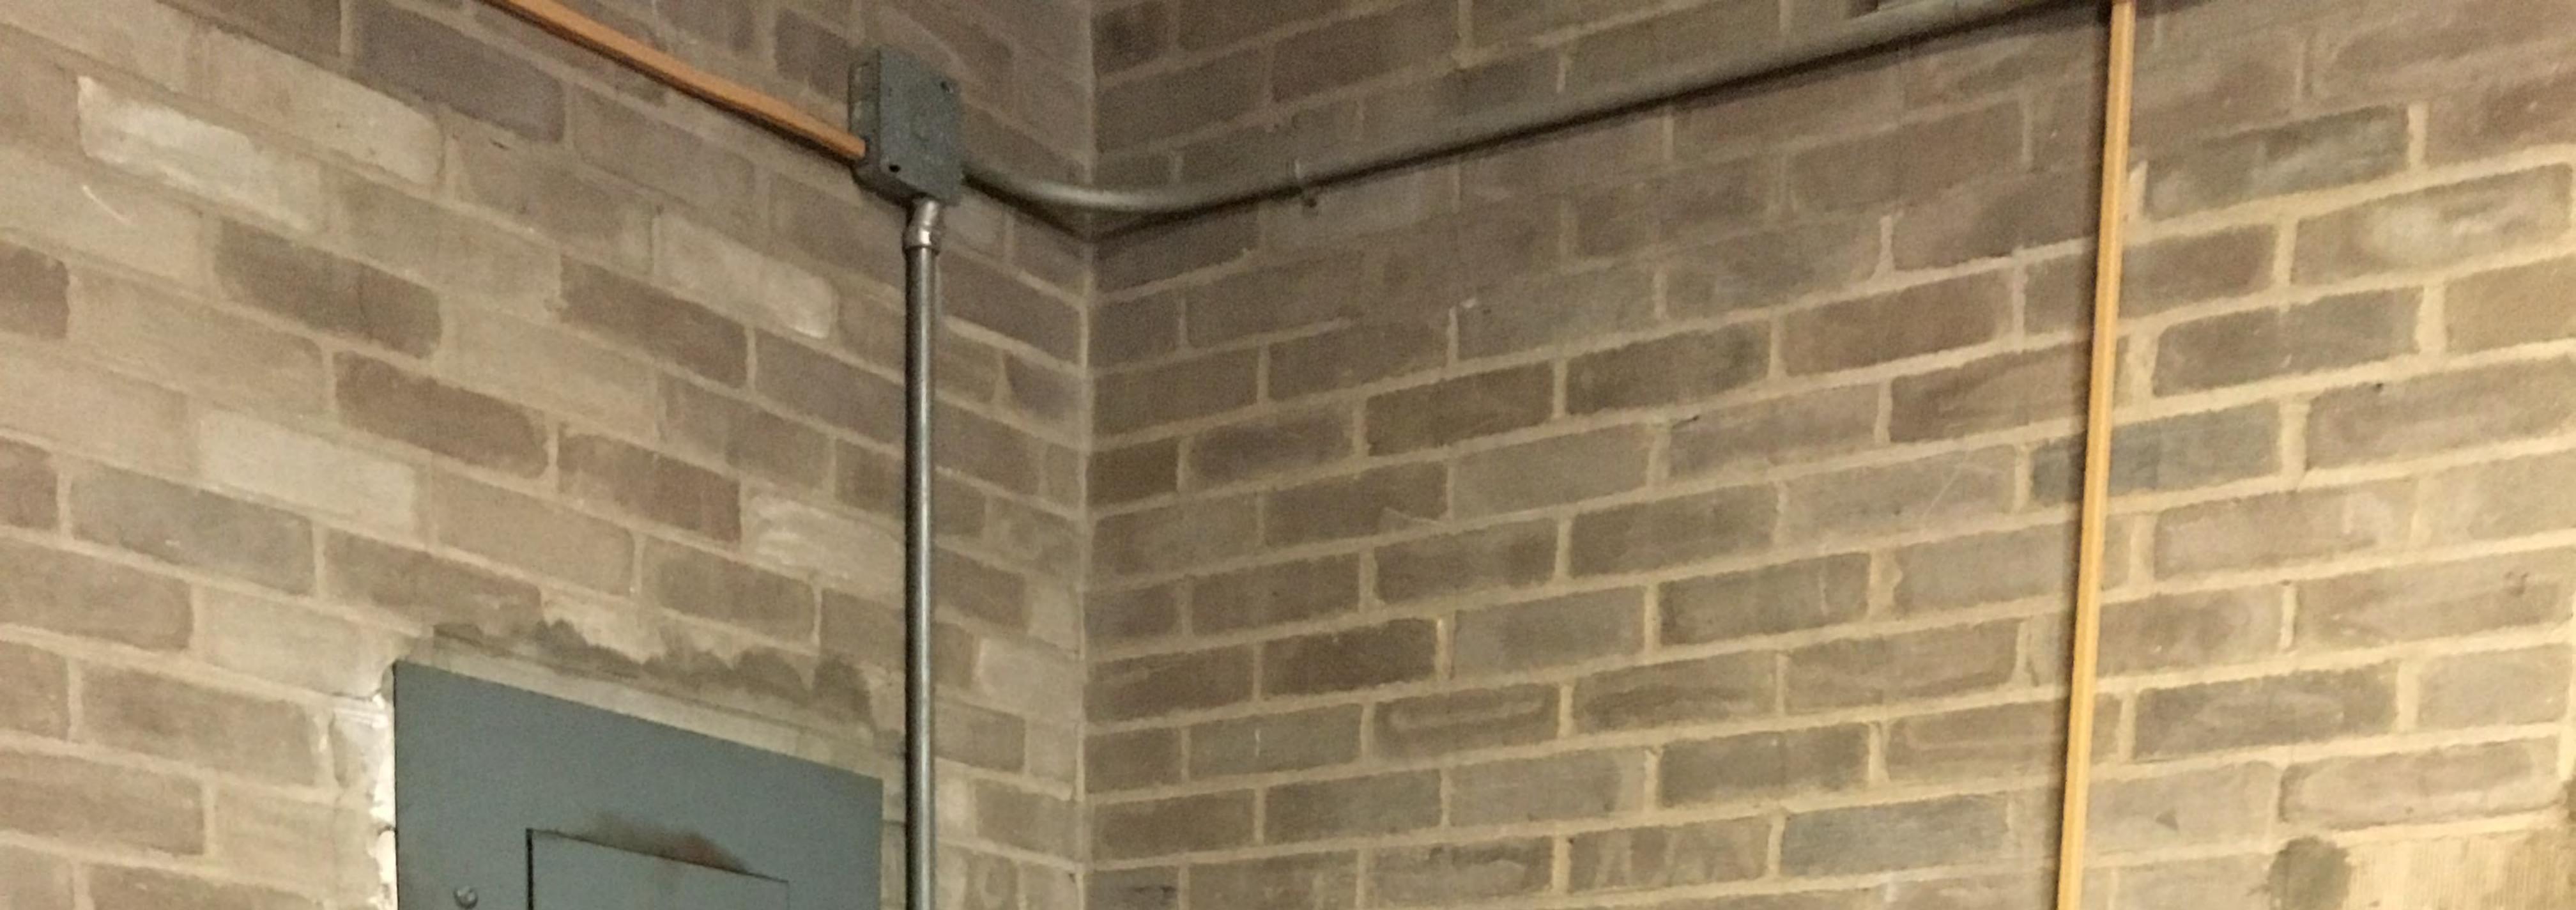

Blocked breaker

12

panel








Electrical hazard




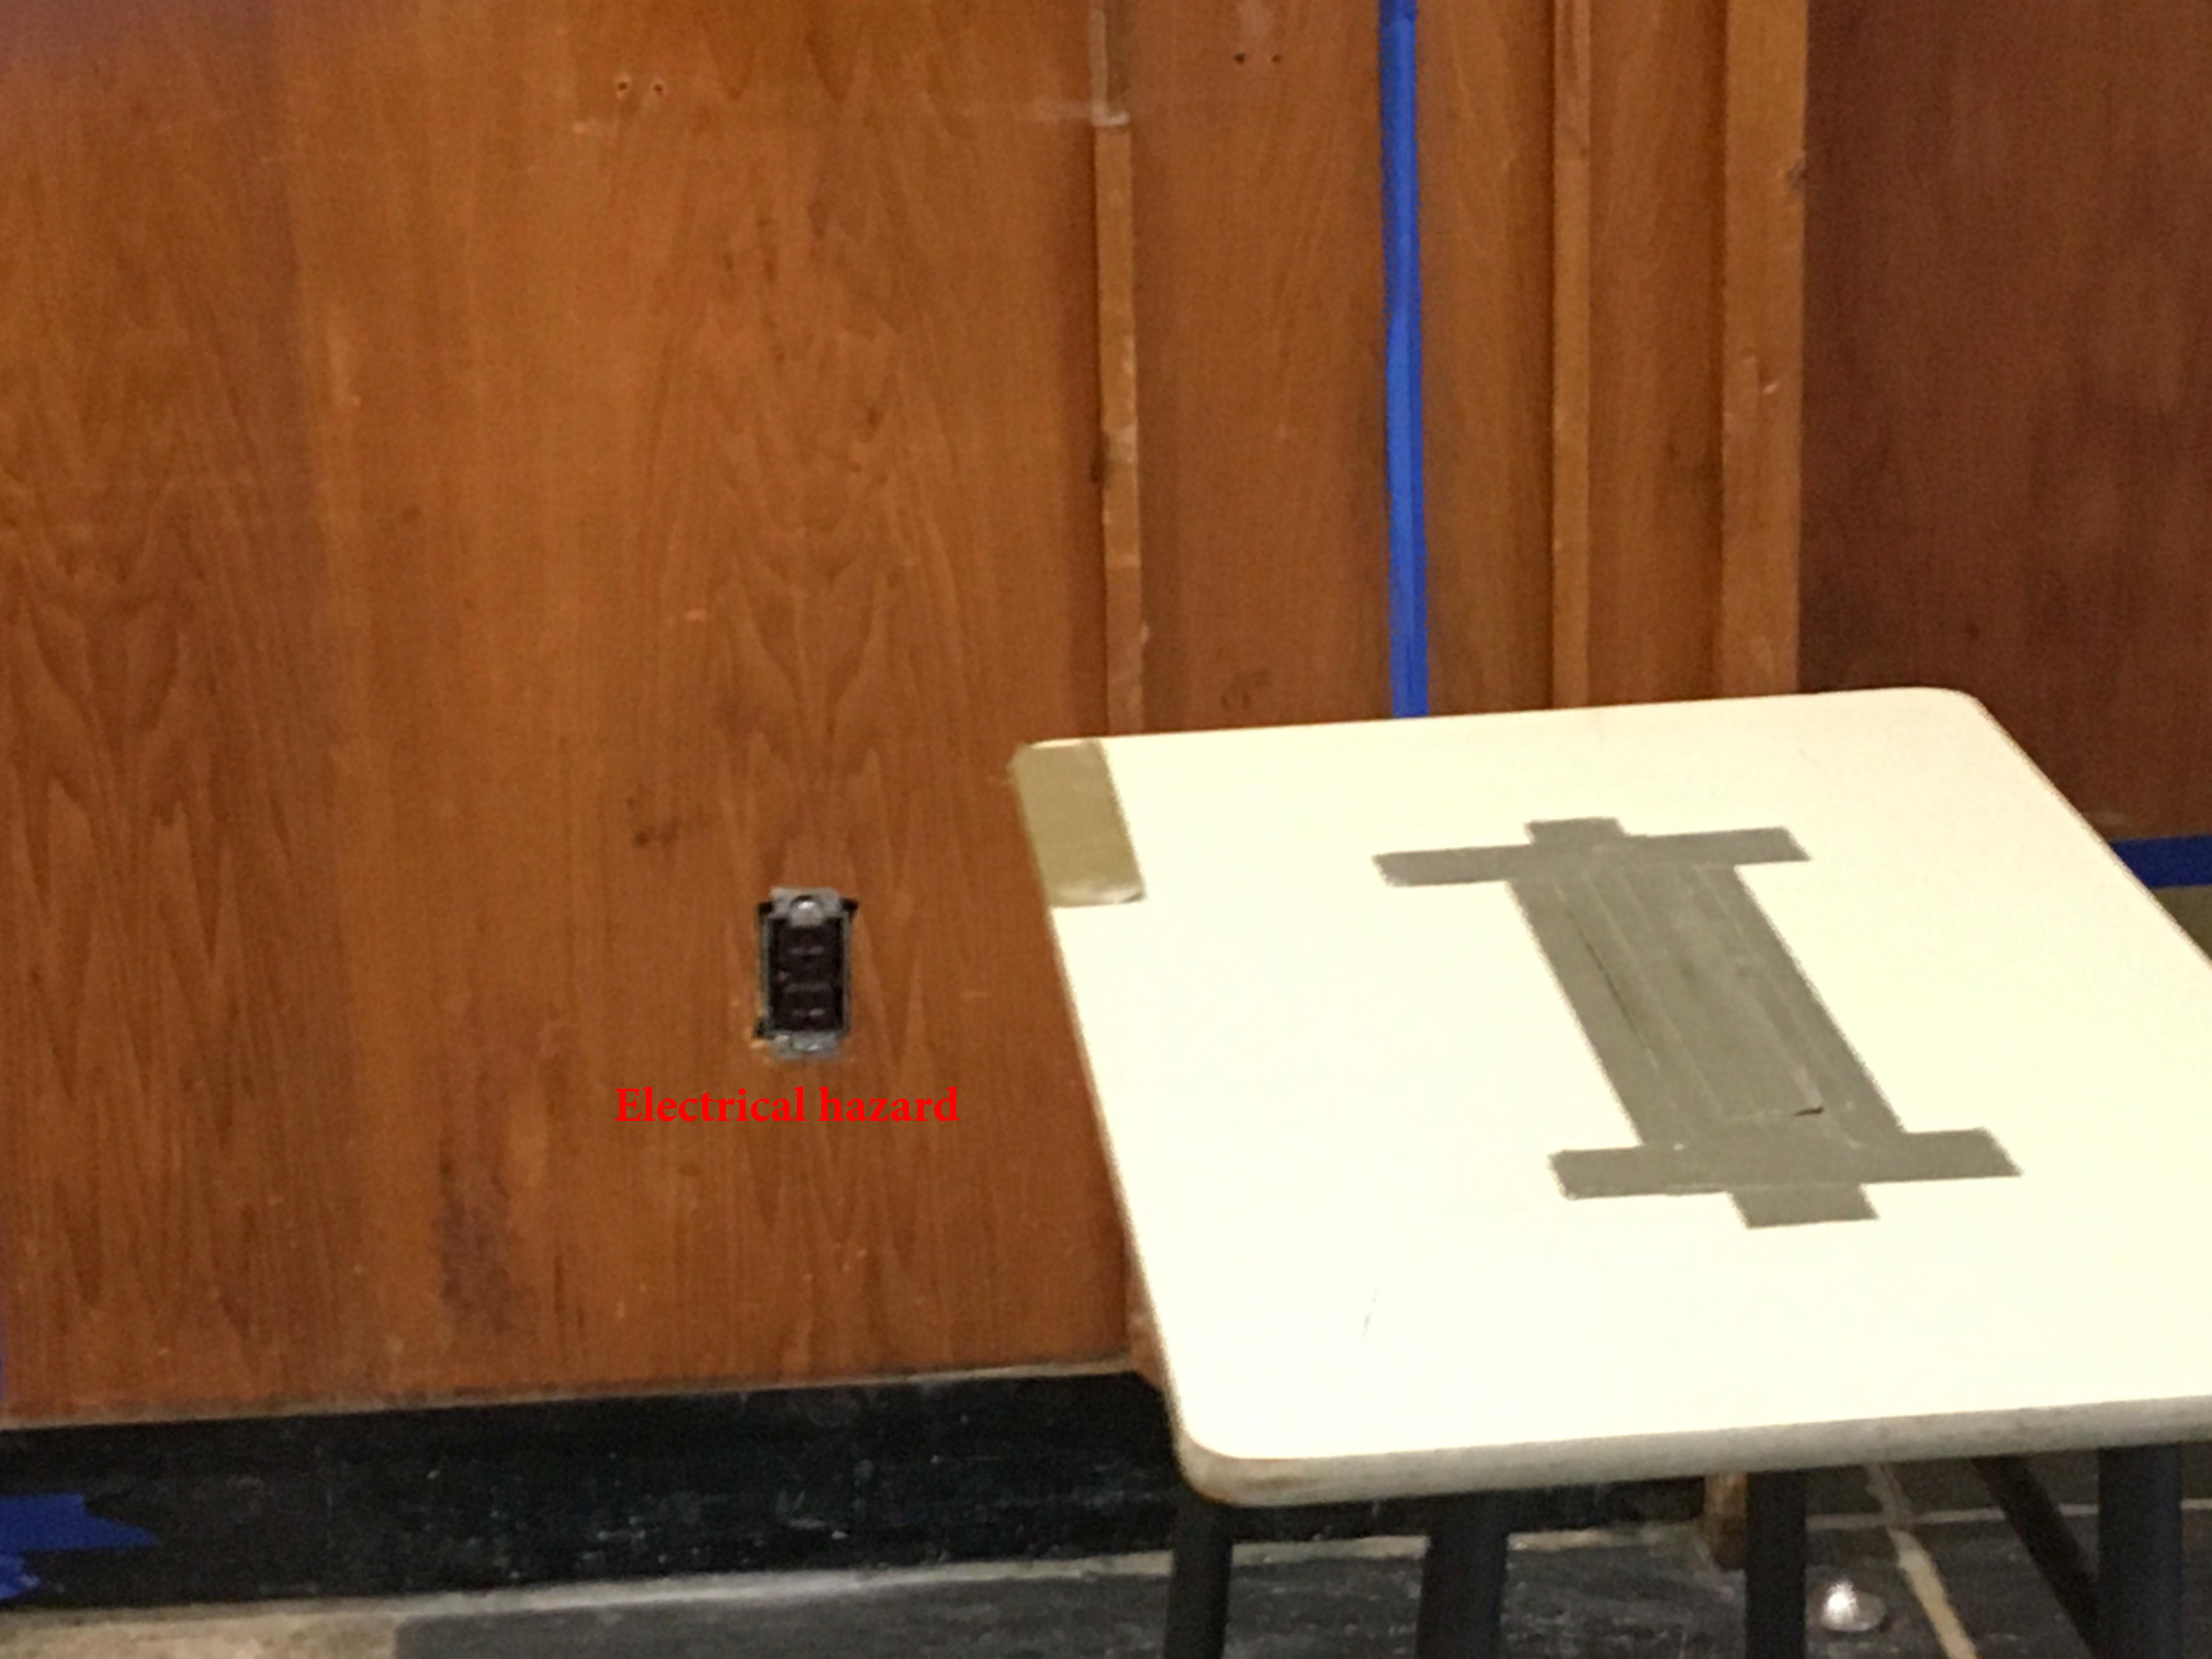







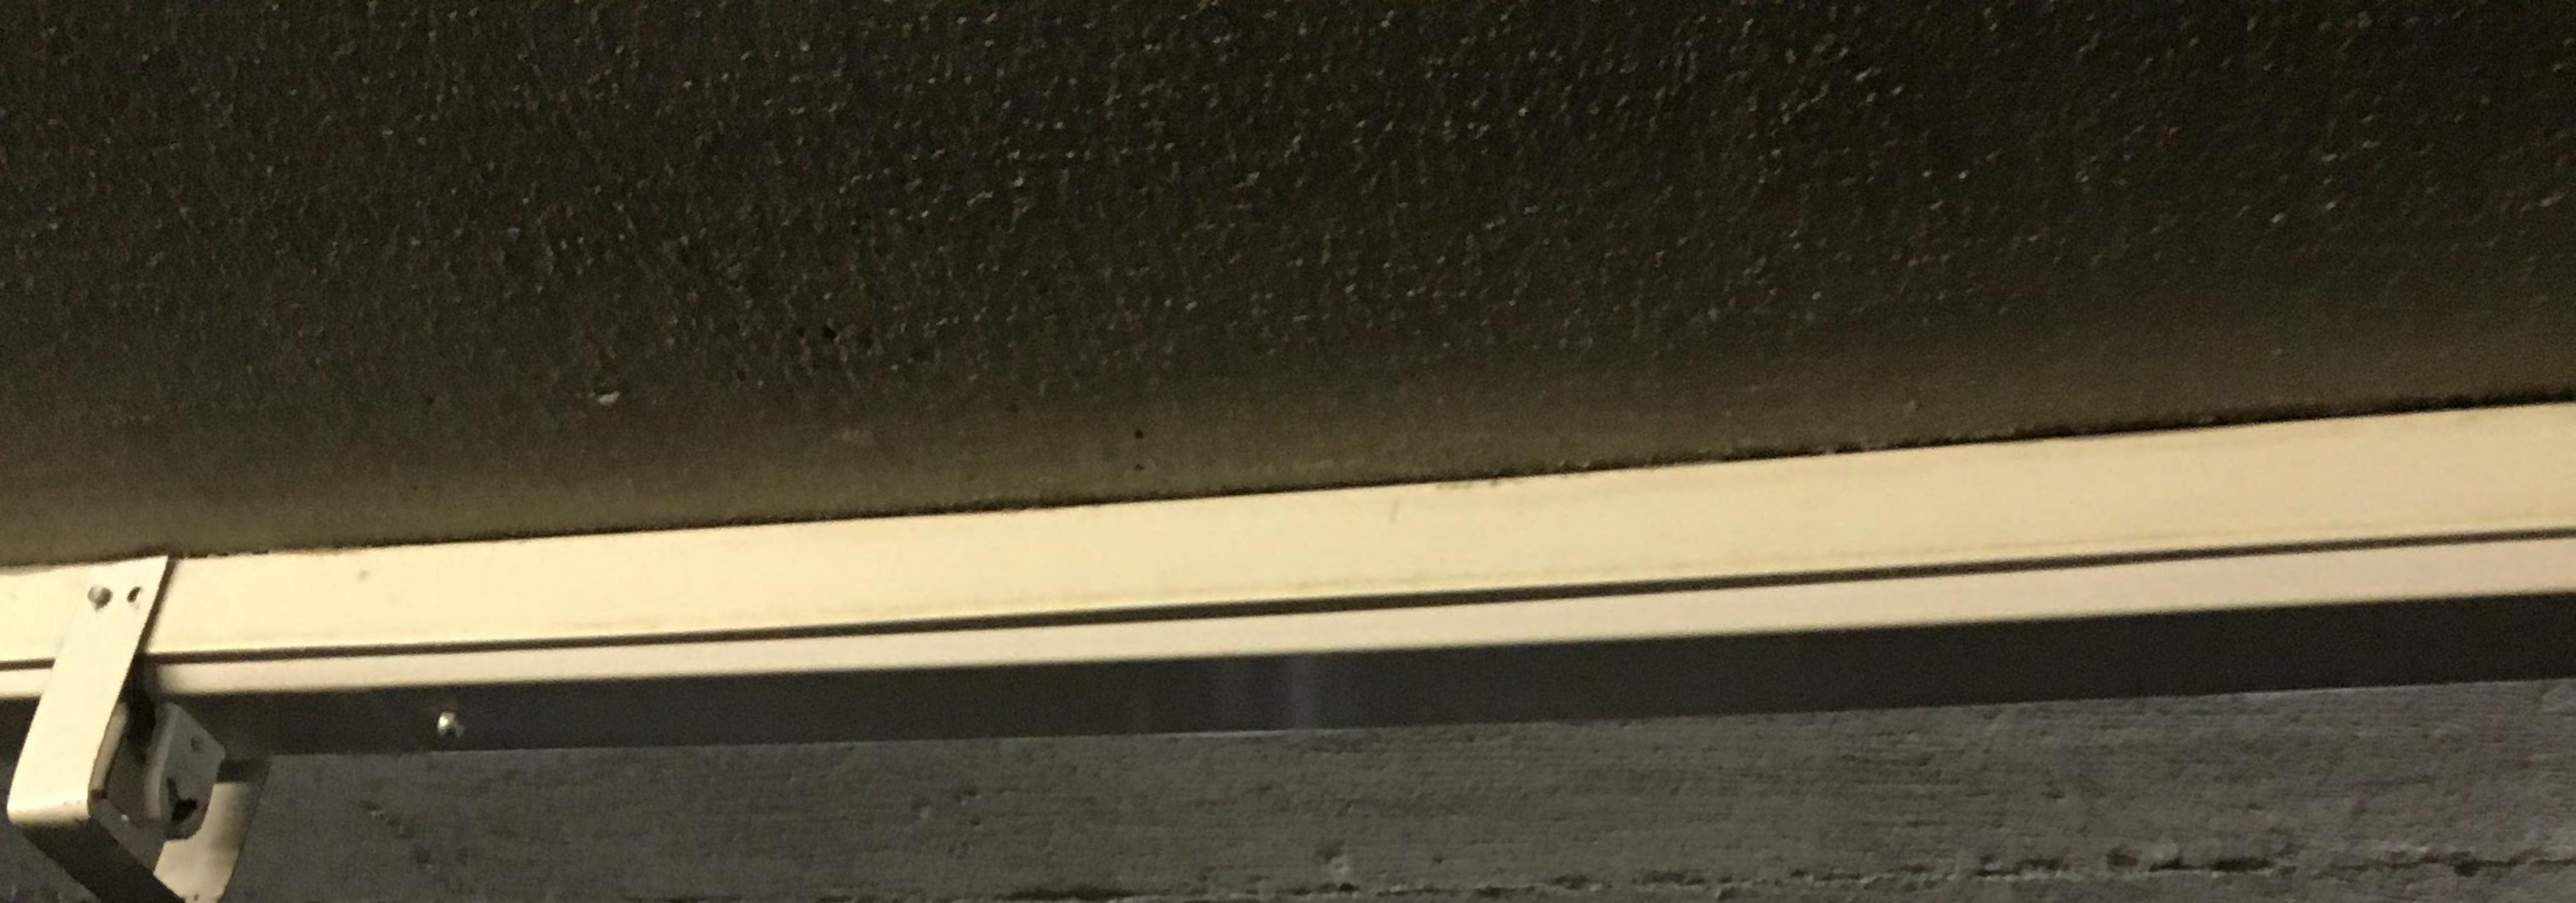

Fire hazard: blocked sprinkler head



10 m

14


ST 844


6350





Fire hazard: displaced smoke barrier

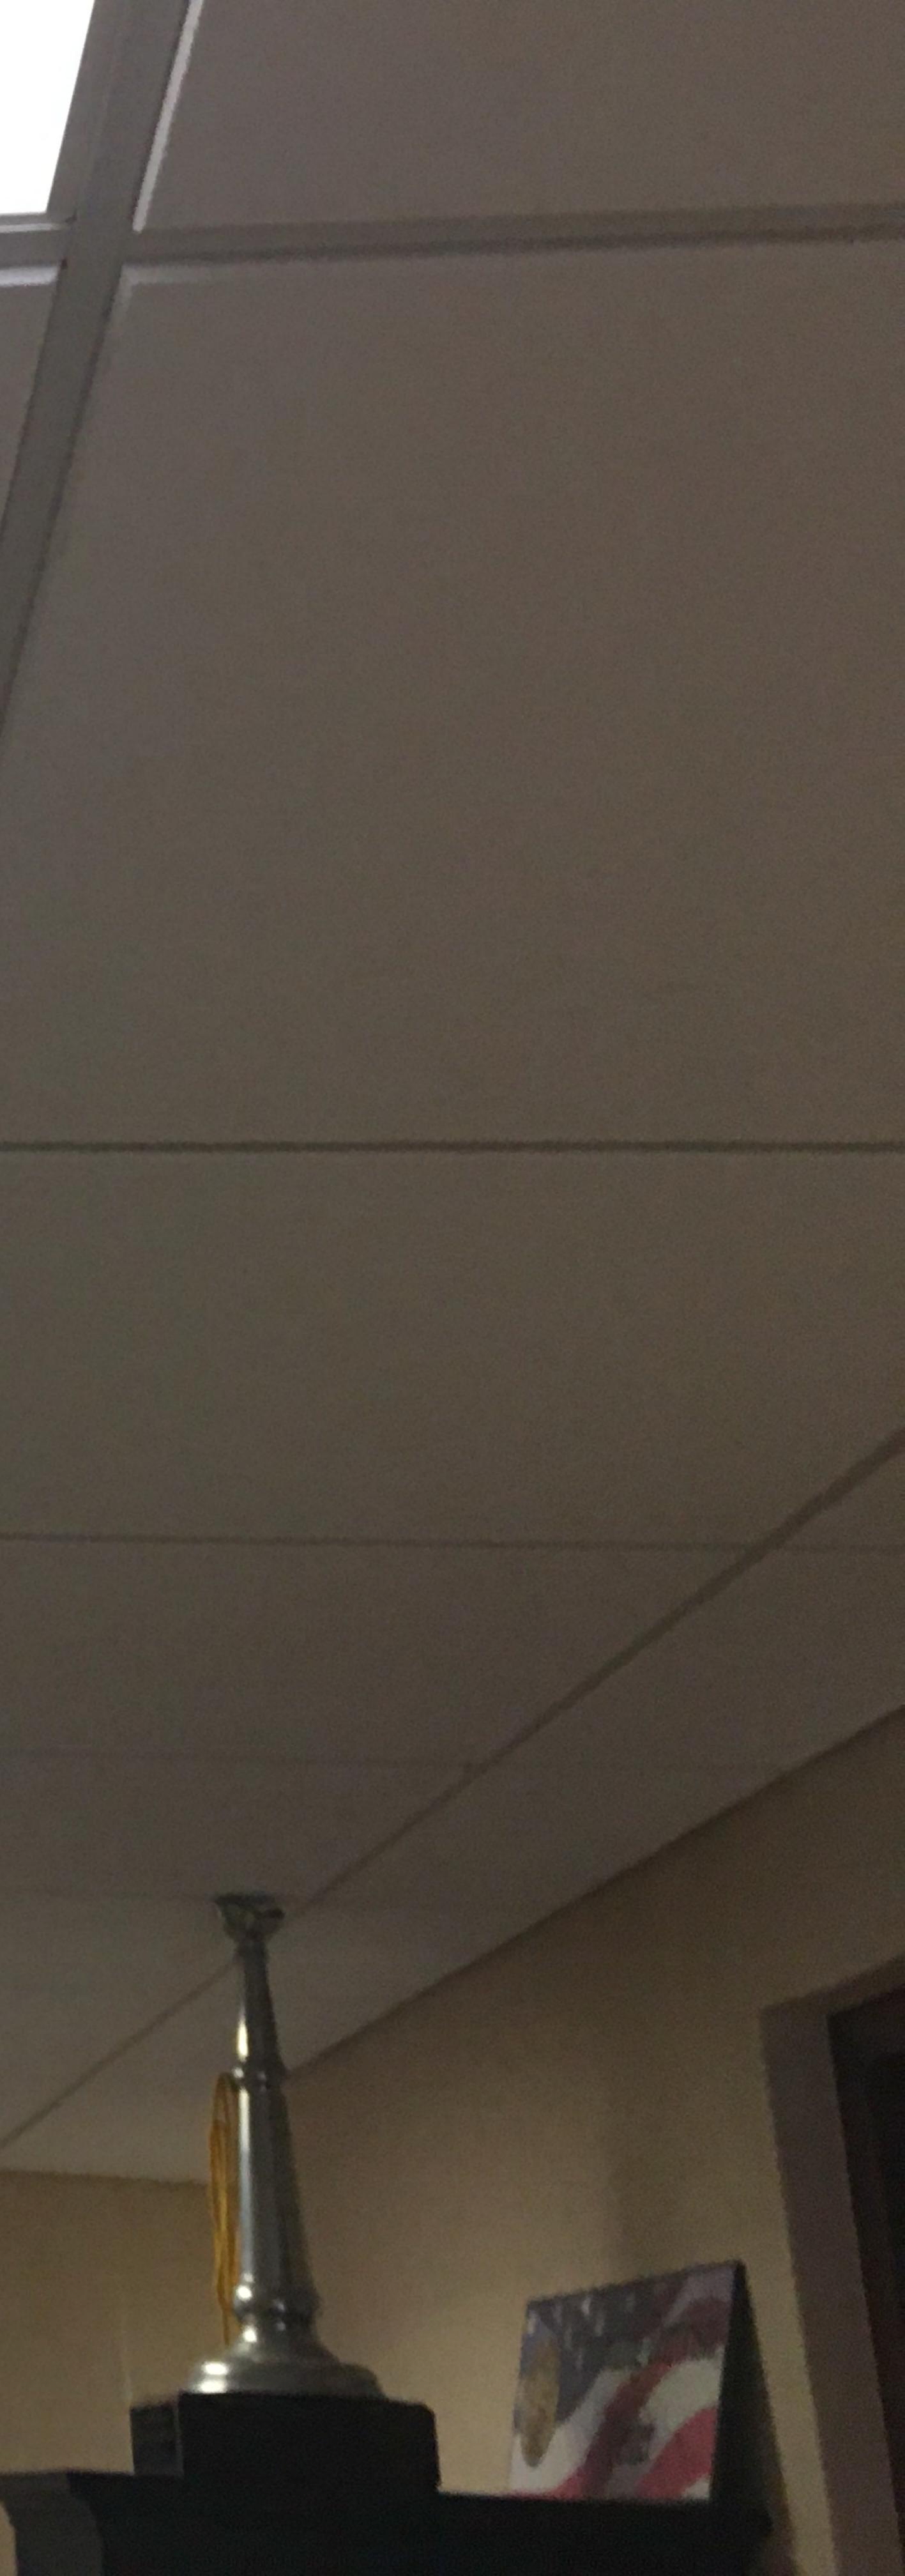

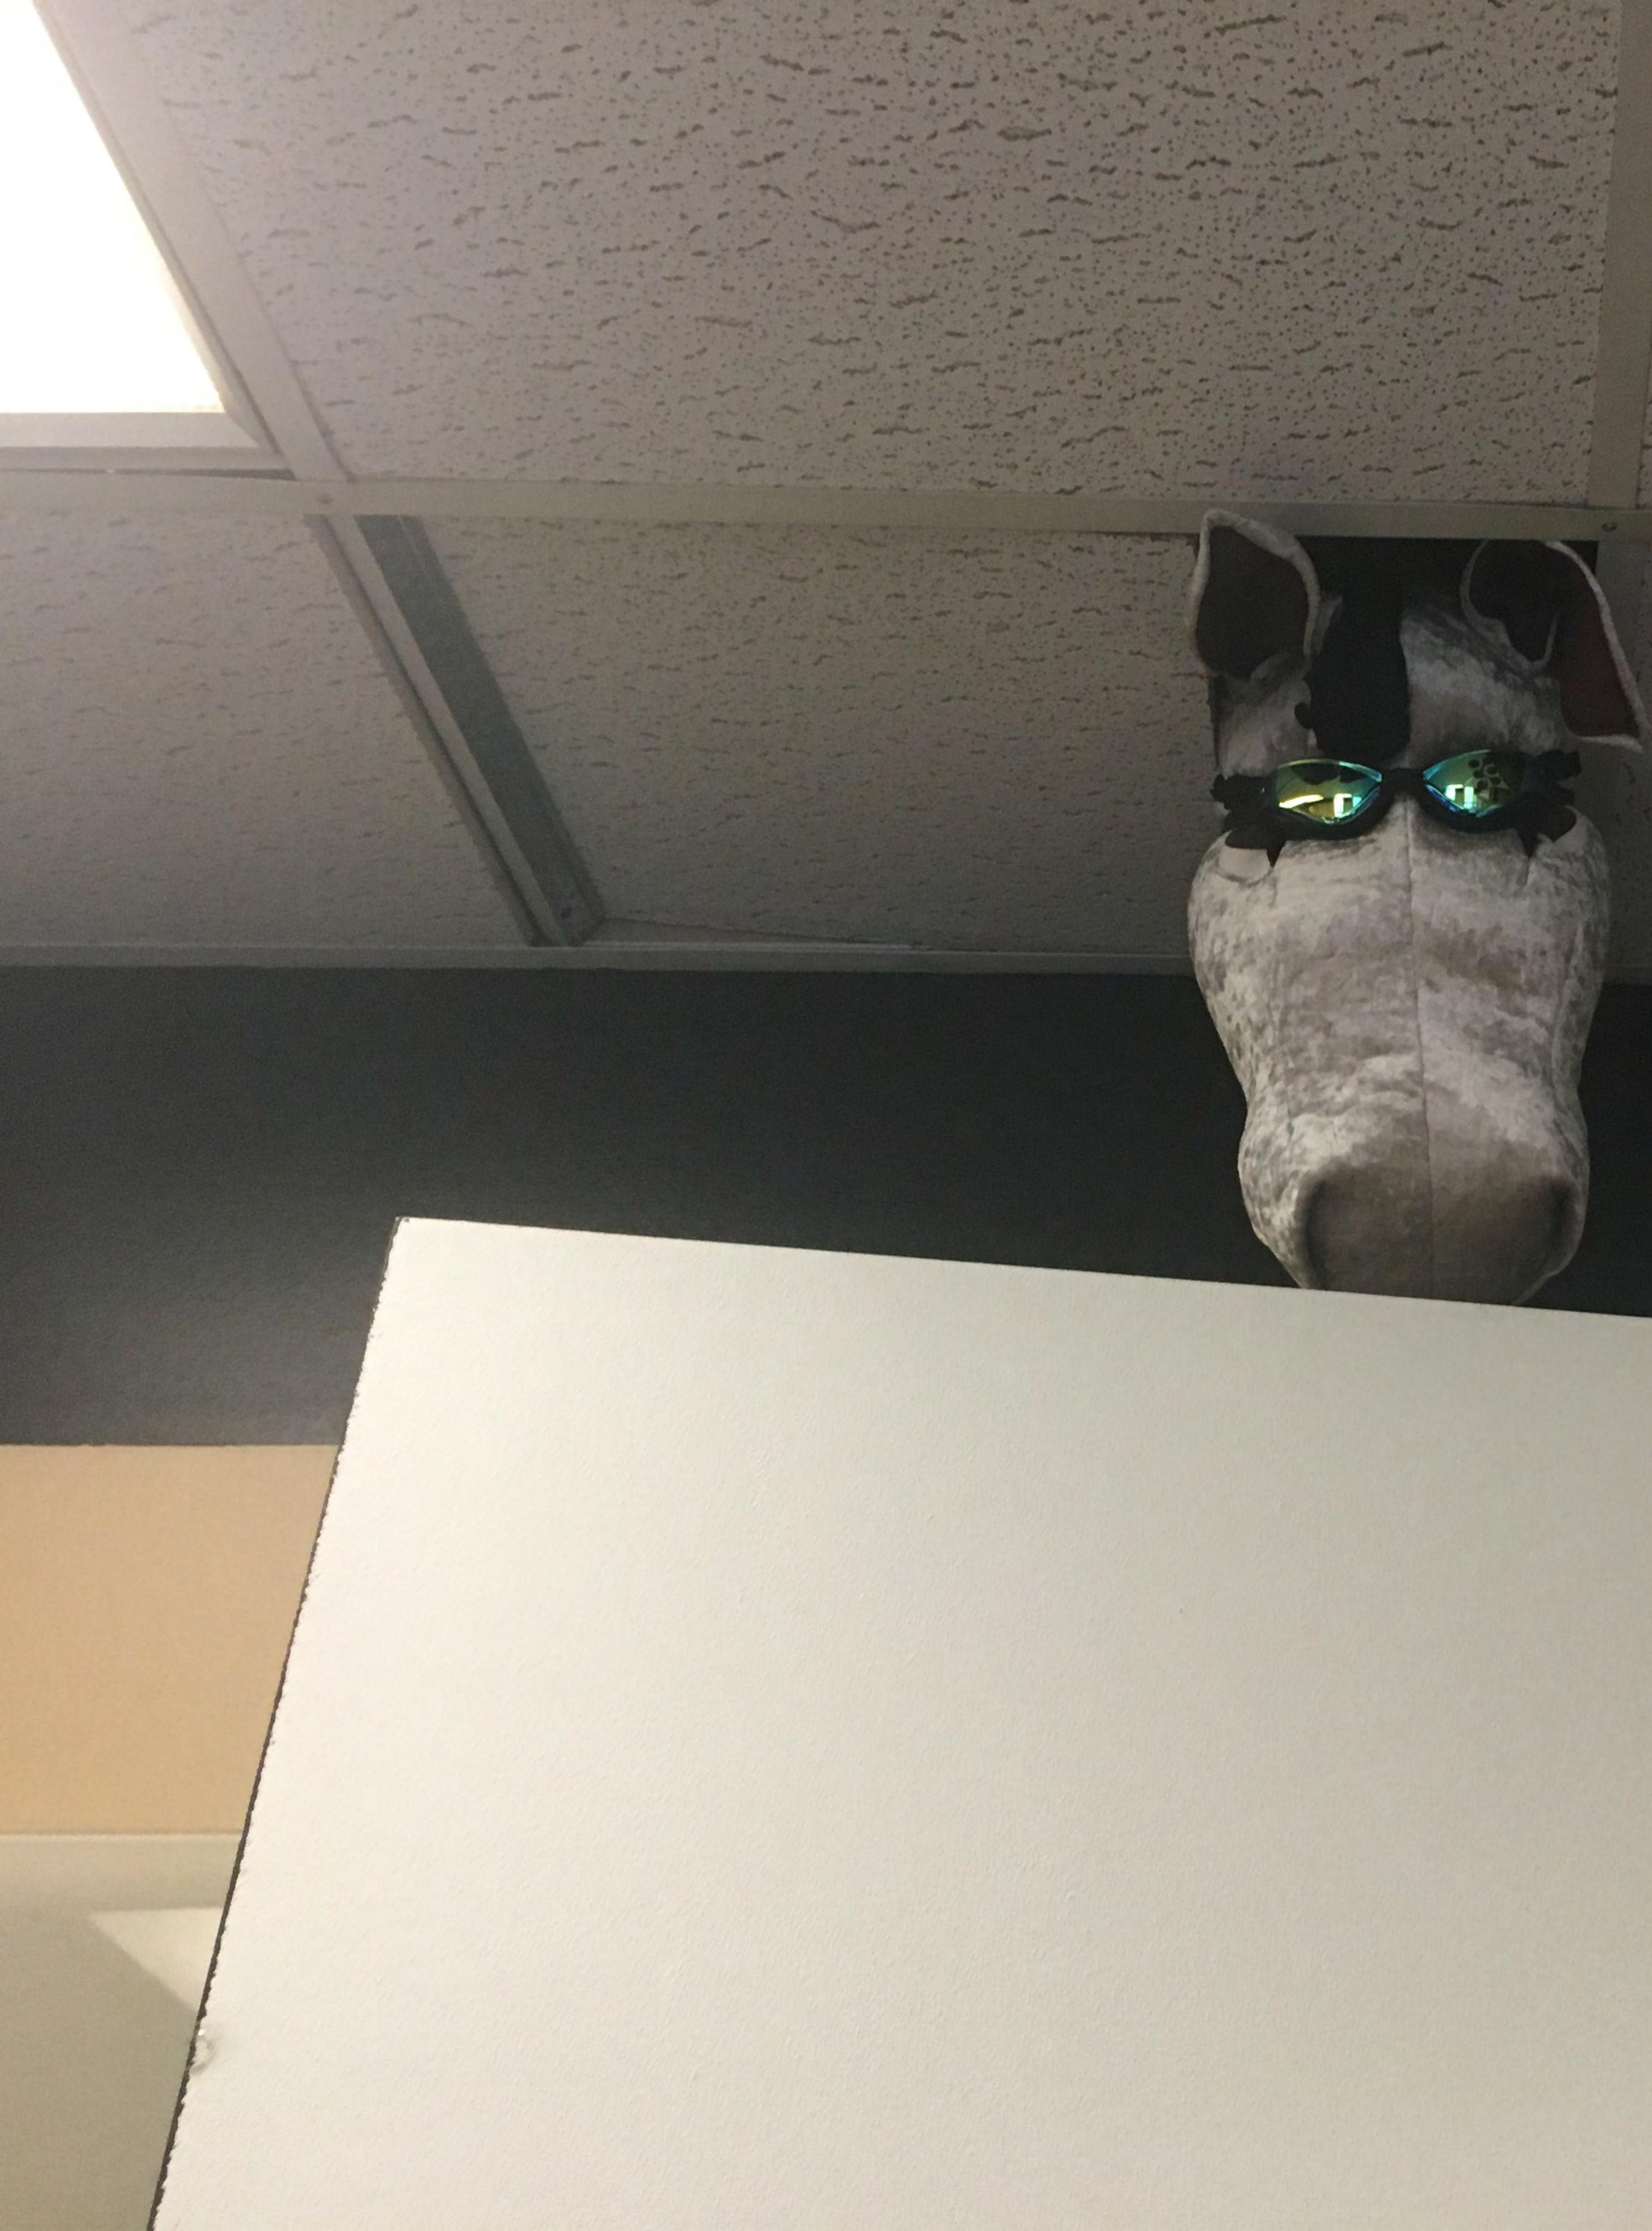


rire nazaro: displaced smoke barrier







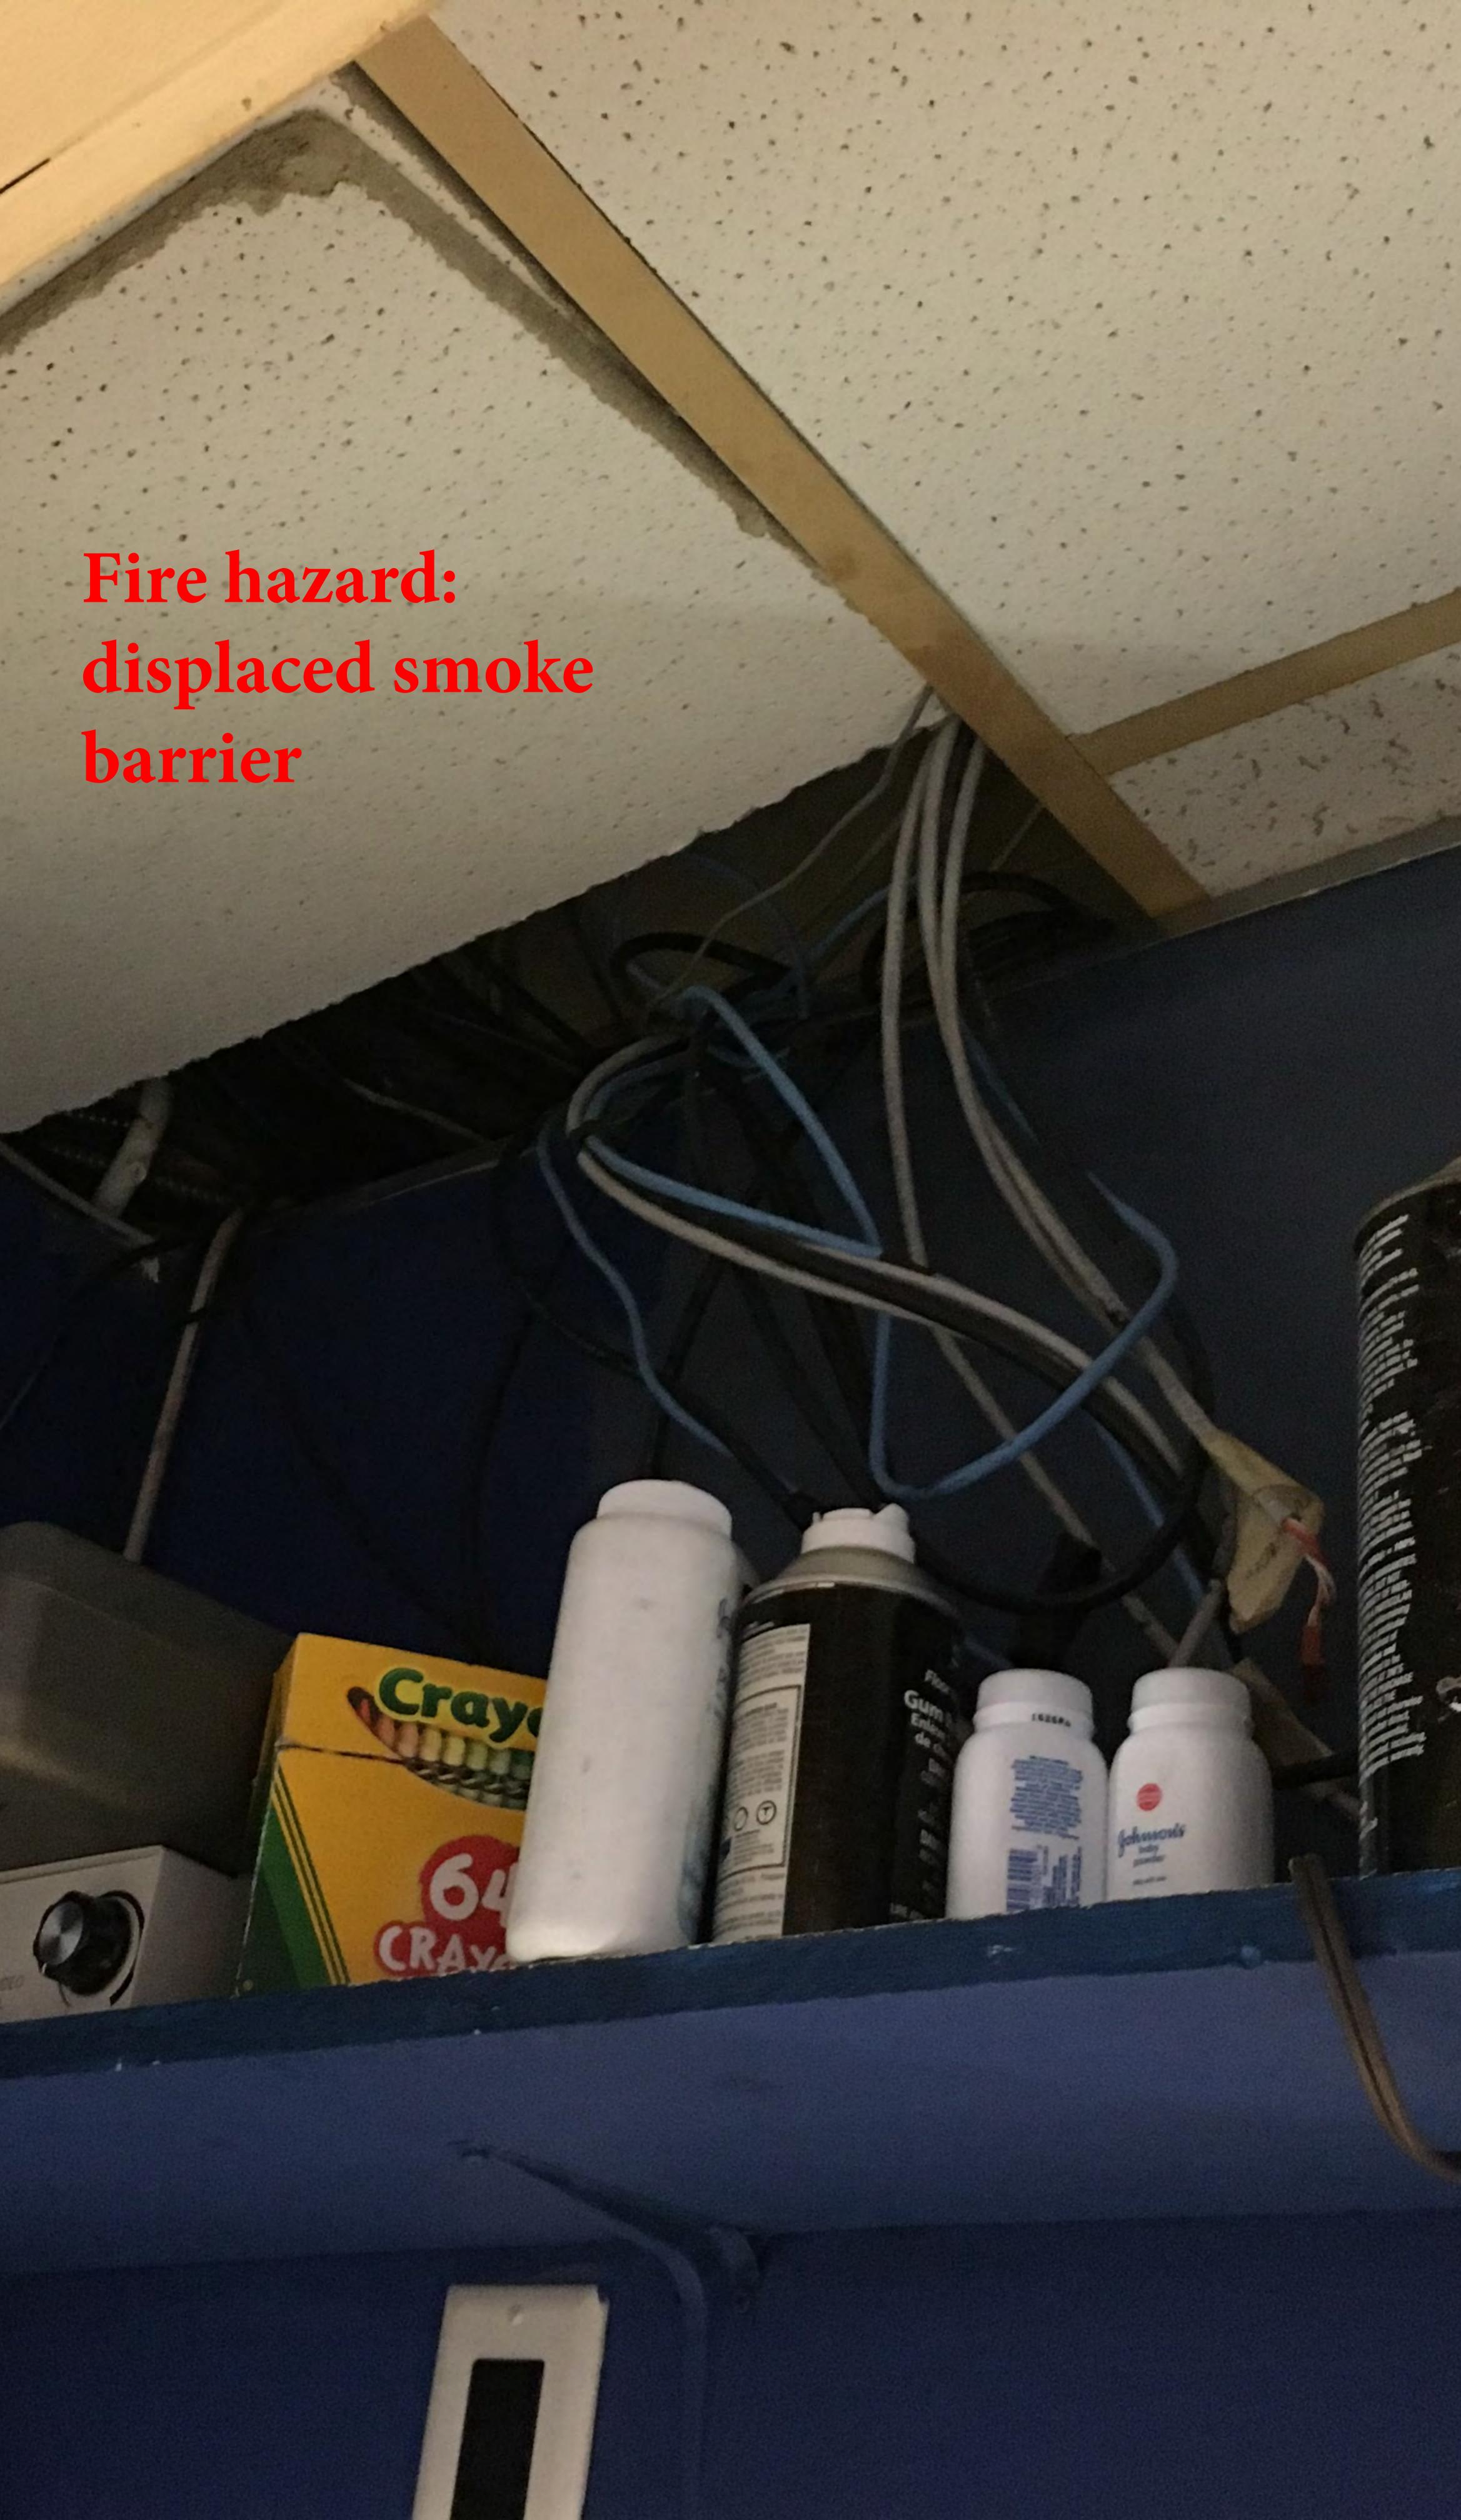



Citrus Base

FDA Accessibile: The accession of the ac

NOT FOR RETAIL/CONSULT

DANGER! EXTREMELY PL VAPOR. VAPORS MAY CAUSE

NET WT. 18.5 07 1

C











-

Safety and health hazard